

# GE-FL60



Rated power operation the maximum temperature of the battery is less than 40°C



BMS integrated technology, power supply redundancy design, support black start function, Off grid operation, etc



Suitable for high rate cyclic charging and discharging scenarios



Lithium Iron Phosphate (LFP) Battery, The battery pack and system adopt an aerosol fire extinguishing solution



Combustible gas, smoke and temperature detection, system active exhaust, and fire alarm



Supports battery expansion, with a maximum capacity of 360KWh

Model		GE-FL60
Main Parameter		
Cell Chemistry		LiFePO4
Module Energy (kWh)		5.12
Module Nominal Voltage (V)		51.2
Module Capacity (Ah)		100
Battery Module Qty In Series		6 (Max)
System Nominal Voltage (V)		307.2
System Operating Voltage (V)		240~350
System Energy (kWh)		61.44
System Usable Energy (kWh) <sup>1</sup>		55.29
Charge/Discharge <sup>2</sup> Current (A)	Recommend	100
	Nominal	100
	Peak Discharge (2 mins, 25°C)	125
Working Temperature (°C)		Charge: 0~55/Discharge: -20~55
Status Indicator		Yellow: Battery High Voltage Power On Red: Battery System Alarm
Communication Port		CAN2.0/ RS485
Humidity		5%~85%RH
Altitude		≤2000m
IP Rating of Enclosure		IP55
Dimension (W/D/H,mm)		735x1045x2235
Weight Approximate (kg)		1015
Installation Location		Floor-Mounted
Storage Temperature (°C)		0~35
Recommend Depth of Discharge		90%
Cycle Life		≥6000(@25°C±2°C,0.5C/0.5C,70%EOL)
Warranty <sup>3</sup>		10 years
Certification		UL1973 /UL9540A/UN38.3

1. DC Usable Energy, test conditions: 90% DOD, 0.3C charge & discharge at 25°C. System usable energy may vary due to system configuration parameters.

2. The current is affected by temperature and SOC.

3. The warranty is due whichever reached first of warranty period or life cycle power.

## Typical application cases

**System Expansion**

**MAX: 60kW/360kWh**



**System Expansion**

**MAX: 360kW/360kWh**




1


n

5

10

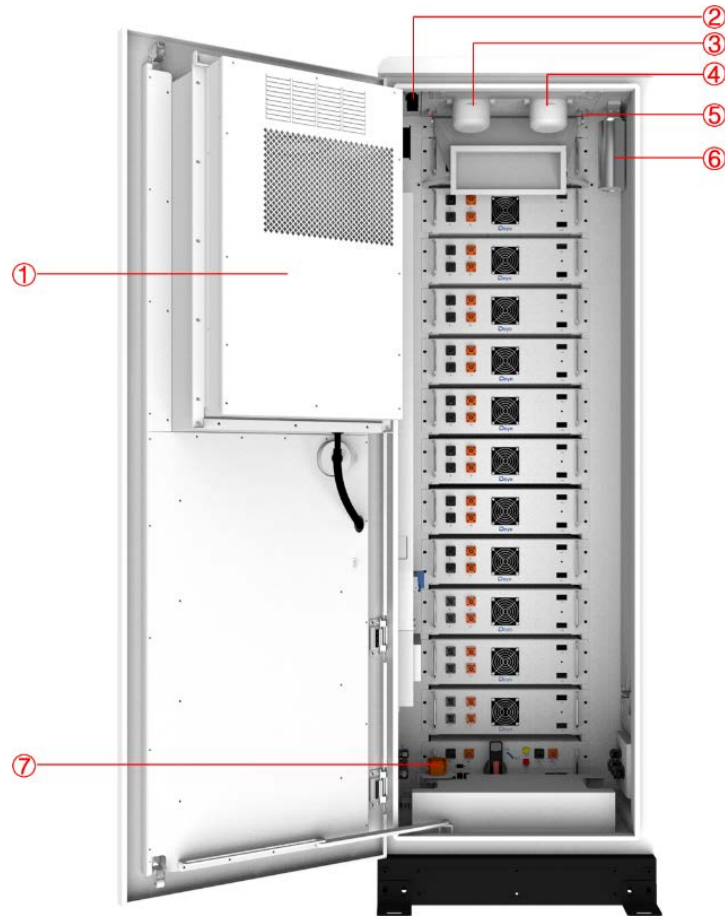


① Air conditioner	Cooling the BESS.
② Travel switch	Check whether the BESS system door is closed.
③ Smoke detector	A device used to detect smoke in a fire and sound an alarm when smoke is detected.
④ Heat detector	A device used to measure temperature and sound an alarm if it detects excessive temperature.
⑤ Fire suppression water pipe	Fire suppression and cooling.
⑥ Aerosol fire extinguishing device	When the BESS is detected to be on fire, aerosol is emitted to extinguish the fire.
⑦ Manual service disconnect	In order to protect the safety of technicians servicing in high voltage environments or respond to sudden events, the connection of the high voltage circuit can be quickly separated.

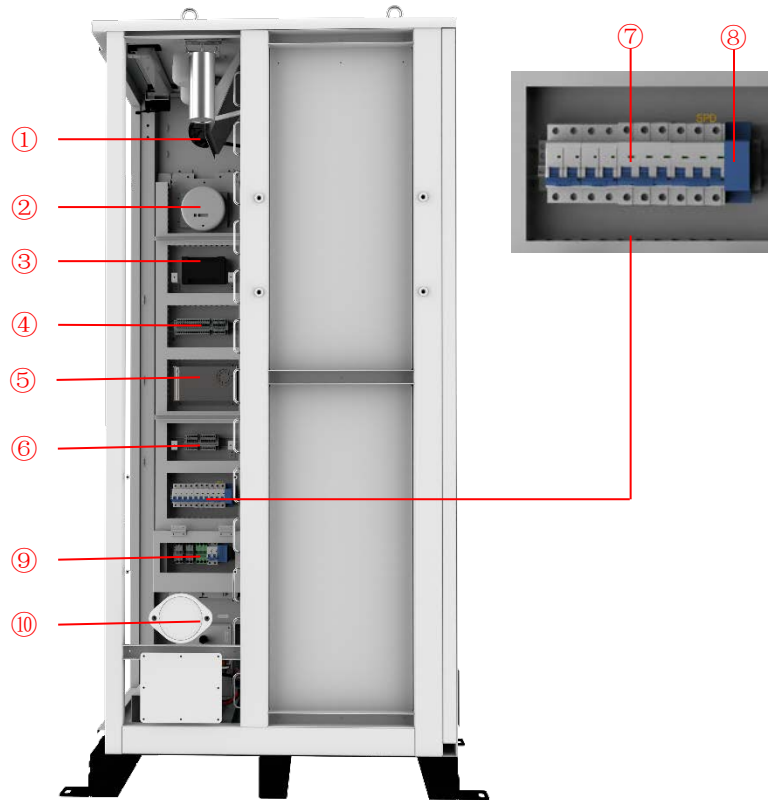


①Air outlet	When combustible gas is detected, the outlet will automatically pop out and need to be manually reset after use.
②Combustible gas sensor	Detect combustible gases
③Serial relay	Control system
④Terminal line	For connecting cables
⑤Switching Mode Power Supply	Power source
⑥Terminal line	For connecting cables
⑦Miniature circuit breaker	Controlled power-on and power-off
⑧Water immersion sensor	Check the ESS for water leakage
⑨Terminal line	Connect external cables
⑩Air inlet	When combustible gas is detected, the inlet will automatically pop out and need to be manually reset after use.



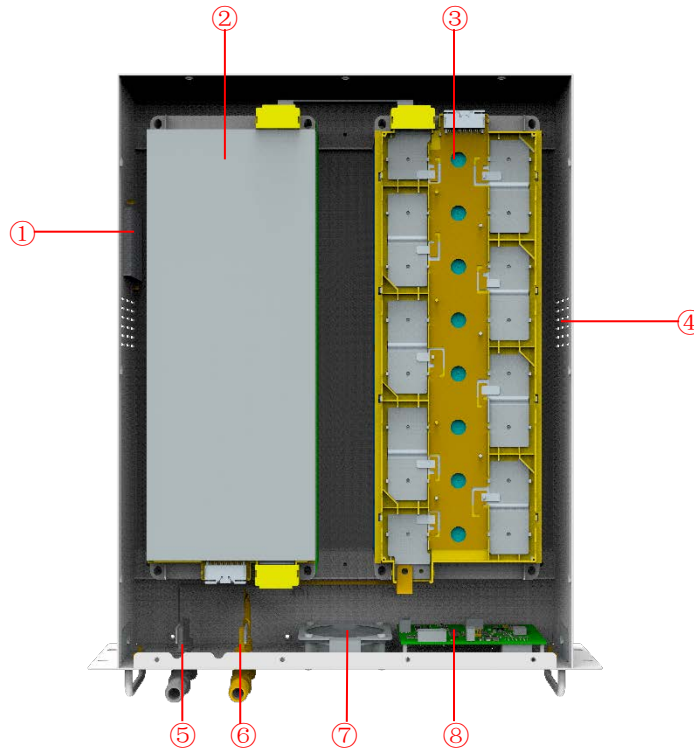

① Aerosol fire extinguishing device	When the pack is detected to be on fire, aerosol is emitted to extinguish the fire.
② Battery module	Provides electrical energy storage and output
③ CCS	Cells Contact System
④ Air inlet	Cold air inlet
⑤ Battery negative-	/
⑥ Battery positive+	/
⑦ Fan	Promote internal and external air flow
⑧ BMU	Battery monitoring

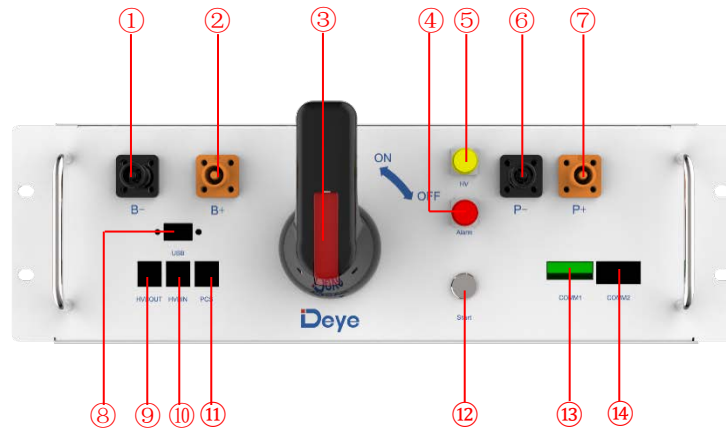

① B-	Connection position of the common negative pole of the battery
② B+	Connection position of the common positive pole of the battery
③ DC switch	Used to manually control the connection between the battery rack and external devices
④ ALRM light indicator	Battery system fault alarm indicator
⑤ HV light indicator	High-voltage hazard indicator
⑥ PCS-	Connection position of PCS negative pole
⑦ PCS+	Connection position of PCS positive pole
⑧ USB	BMS upgrade interface and storage expansion interface
⑨ OUT COM	Connection position with next HVB-100A 750V communication output
⑩ IN COM	Connection position with previous HVB-100A750V communication input
⑪ PCS COM	Communication interface with charging and discharging equipment
⑫ START	A start switch of 12VDC power inside the high-voltage control box
⑬ COMM1	Communicative connection with the cabinet
⑭ COMM2	Communicative connection with the first battery module; and providing 12VDC power for the first battery module.